
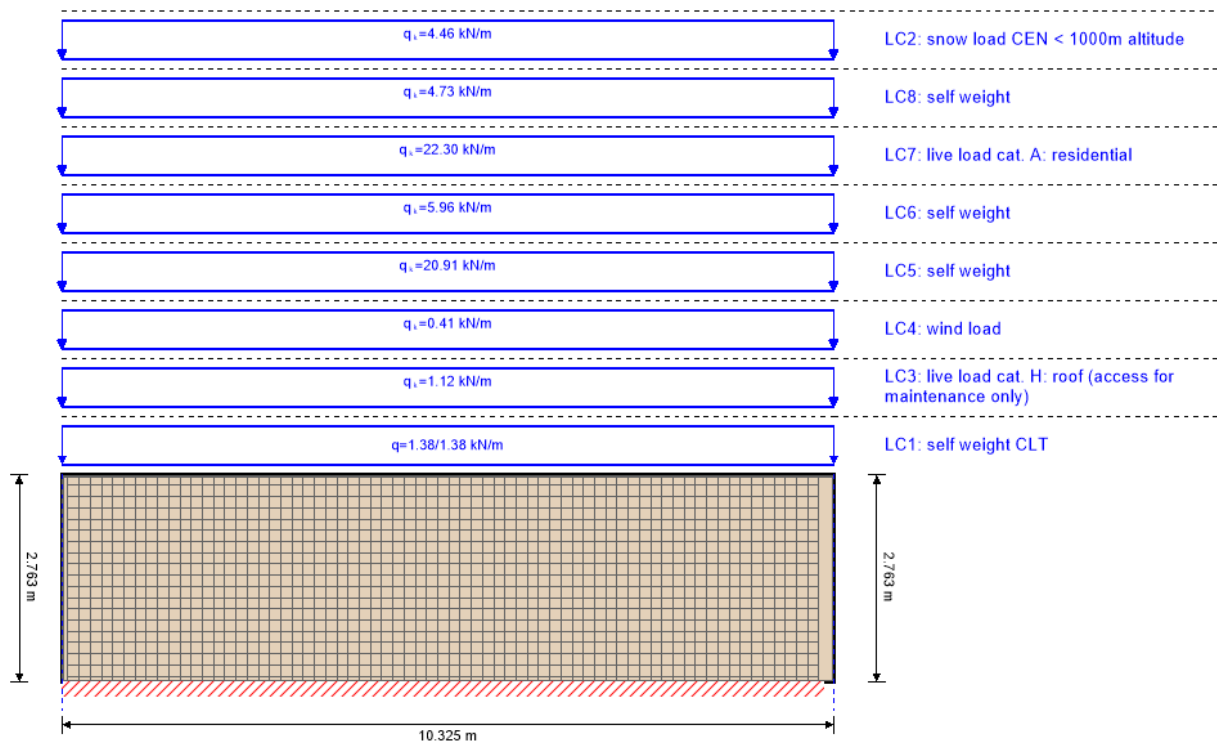


system



global utilization ratio					155 %
ULS	19 %	ULS fire	155 %	SLS	0 %

section: CLT 100 L3s				
	layer	thickness	orientation	material
	1	30.0 mm	0°	C24 spruce ETA (2019)
	2	40.0 mm	90°	C24 spruce ETA (2019)
	3	30.0 mm	0°	C24 spruce ETA (2019)
	t _{CLT}	100.0 mm		

section fire: CLT 100 L3s									
	layer		thickness		orientation		material		
	1		30.0 mm		0°		C24 spruce ETA (2019)		
	2		23.0 mm		90°		C24 spruce ETA (2019)		
	t _{CLT}		53.0 mm						
fire resistance class:R 90									
fire protection layering : 2 x 12.5 mm gypsum plasterboard Type F									
gypsum plasterboard Type A (acc. to EN 520)gypsum plasterboard Type F (acc. to EN 520)									
time		90 min							
t _{ch,h}	t _{f,h}	t _{a,h}	d _{la,h}	k ₀	d ₀	d _{char,0,h}	d _{ef,h}		
[min]	[min]	[min]	[mm]	[-]	[mm]	[mm]	[mm]		
49	54	72	25	1	7	40.0	47.0		

material values										
material	$f_{m,k}$	$f_{t,0,k}$	$f_{t,90,k}$	$f_{c,0,k}$	$f_{c,90,k}$	$f_{v,k}$	$f_{r,k \min}$	$E_{0,mean}$	G_{mean}	$G_{r,mean}$
	[N/mm ²]	[N/mm ²]	[N/mm ²]	[N/mm ²]	[N/mm ²]	[N/mm ²]	[N/mm ²]	[N/mm ²]	[N/mm ²]	[N/mm ²]
C24 spruce ETA (2019) C24 spruce ETA (2019)	24.00	14.00	0.12	21.00	2.50	4.00	1.25	12,000.00	690.00	50.00

load

load case groups										
	load case category	Typ	duration	Kmod	γ_{inf}	γ_{sup}	Ψ_0	Ψ_1	Ψ_2	
LC1	self weight CLT	G	permanent	0.6	1	1.35	1	1	1	
LC1	self weight CLT	G	permanent							
LC2	snow load CEN < 1000m altitude	Q	short term	0.9	0	1.5	0.5	0.2	0	
LC2	snow load CEN < 1000m altitude	Q	short term							
LC3	live load cat. H: roof (access for maintenance only)	Q	short term	0.9	0	1.5	0	0	0	
LC3	live load cat. H: roof (access for maintenance only)	Q	short term							
LC4	wind load	Q	short term	0.9	0	1.5	0.6	0.2	0	
LC4	wind load	Q	short term							
LC5	self weight	G	permanent	0.6	1	1.35	1	1	1	
LC5	self weight	G	permanent							
LC6	self weight	G	permanent	0.6	1	1.35	1	1	1	
LC6	self weight	G	permanent							
LC7	live load cat. A: residential	Q	medium term	0.8	0	1.5	0.7	0.5	0.3	
LC7	live load cat. A: residential	Q	medium term							
LC8	self weight	G	permanent	0.6	1	1.35	1	1	1	
LC8	self weight	G	permanent							

LC1:self weight CLT			
trapezoidal load			
distance from start	$q_{k,a}$	load at end	load length
[m]	[kN/m]		[m]
0.000	1.3815	1.38	10.325

LC2:snow load CEN < 1000m altitude	
continuous load	
q_k	
[kN/m]	
4.46	

LC3:live load cat. H: roof (access for maintenance only)	
continuous load	
q_k	
[kN/m]	
1.115	

LC4:wind load

continuous load

q_k

[kN/m]

0.41

LC5:self weight

continuous load

q_k

[kN/m]

20.91

LC6:self weight

continuous load

q_k

[kN/m]

5.957

LC7:live load cat. A: residential

continuous load

q_k

[kN/m]

22.3

LC8:self weight

continuous load

q_k

[kN/m]

4.7319

ULS combinations


	combination rule
LCO1	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8$
LCO1	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8$
LCO2	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC2$
LCO2	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC2$
LCO3	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC2 + 1.50/0.00 * 0.00 * LC3$
LCO3	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC2 + 1.50/0.00 * 0.00 * LC3$
LCO4	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC2 + 1.50/0.00 * 0.00 * LC3 + 1.50/0.00 * 0.60 * LC4$
LCO4	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC2 + 1.50/0.00 * 0.00 * LC3 + 1.50/0.00 * 0.60 * LC4$
LCO5	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC2 + 1.50/0.00 * 0.00 * LC3 + 1.50/0.00 * 0.60 * LC4 + 1.50/0.00 * 0.70 * LC7$
LCO5	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC2 + 1.50/0.00 * 0.00 * LC3 + 1.50/0.00 * 0.60 * LC4 + 1.50/0.00 * 0.70 * LC7$
LCO6	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC3$
LCO6	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC3$
LCO7	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC3 + 1.50/0.00 * 0.50 * LC2$
LCO7	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC3 + 1.50/0.00 * 0.50 * LC2$
LCO8	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC3 + 1.50/0.00 * 0.50 * LC2 + 1.50/0.00 * 0.60 * LC4$
LCO8	$1.35/1.00 * LC1 + 1.35/1.00 * LC5 + 1.35/1.00 * LC6 + 1.35/1.00 * LC8 + 1.50/0.00 * LC3 + 1.50/0.00 * 0.50 * LC2 + 1.50/0.00 * 0.60 * LC4$

[illegible]

ULS combinations fire	
	combination rule
LCO13 LCO13	1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.00 * LC4 + 1.00/0.00 * 0.00 * LC2 + 1.00/0.00 * 0.00 * LC3 + 1.00/0.00 * 0.30 * LC7 1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.00 * LC4 + 1.00/0.00 * 0.00 * LC2 + 1.00/0.00 * 0.00 * LC3 + 1.00/0.00 * 0.30 * LC7
LCO14 LCO14	1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.30 * LC7 1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.30 * LC7
LCO15 LCO15	1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.30 * LC7 + 1.00/0.00 * 0.00 * LC2 1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.30 * LC7 + 1.00/0.00 * 0.00 * LC2
LCO16 LCO16	1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.30 * LC7 + 1.00/0.00 * 0.00 * LC2 + 1.00/0.00 * 0.00 * LC3 1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.30 * LC7 + 1.00/0.00 * 0.00 * LC2 + 1.00/0.00 * 0.00 * LC3
LCO17 LCO17	1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.30 * LC7 + 1.00/0.00 * 0.00 * LC2 + 1.00/0.00 * 0.00 * LC3 + 1.00/0.00 * 0.00 * LC4 1.00/1.00 * LC1 + 1.00/1.00 * LC5 + 1.00/1.00 * LC6 + 1.00/1.00 * LC8 + 1.00/0.00 * 0.30 * LC7 + 1.00/0.00 * 0.00 * LC2 + 1.00/0.00 * 0.00 * LC3 + 1.00/0.00 * 0.00 * LC4


Ultimate limit state (ULS) - design results

utilization rate of shear stress in plane on net section

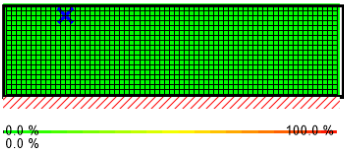


LCO14							
Id	X	Z	k_{mod}	$f_{IP,Netto,k}$	Q	$T_{IP,Net,d}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[N/mm ²]	[%]
1169	1.875	2.475	0.8	3.9	0.00	0.00	0 %

utilization rate of shear stress in plane of gross section

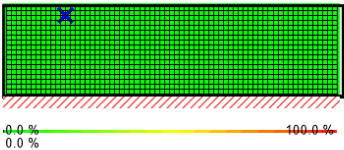

LCO14							
Id	X	Z	k_{mod}	$f_{v,IP,Brutto,k}$	Q	$\tau_{IP,Gross,d}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[N/mm ²]	[%]
1169	1.875	2.475	0.8	3.5	0.00	0.00	0 %


utilization rate of torsional shear stress in face glued surfaces

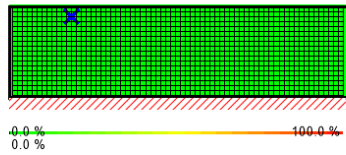

LCO14

Id	X	Z	k_{mod}	$f_{v,IP,T,k}$	Q	$T_{T,Node,d}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[N/mm ²]	[%]
1169	1.875	2.475	0.8	2.5	0.00	0.00	0 %


utilization rate of axial force horizontal

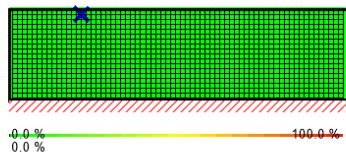

LCO14

Id	X	Z	k_{mod}	$f_{m,k}$	$N_{h,max}$	M_y	$\sigma_{h,max}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[kNm]	[N/mm ²]	[%]
1239	2.175	2.625	0.8	24.0	0.0000	0.0000	0.00	0 %


utilization rate of axial force vertical

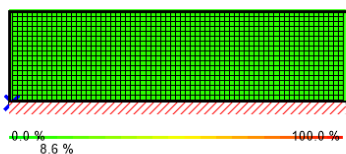

LCO14

Id	X	Z	k_{mod}	$f_{m,k}$	$N_{v,max}$	M_y	$\sigma_{v,max}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[kNm]	[N/mm ²]	[%]
1	0.075	0	0.8	24.0	1.8394	0.0000	1.32	9 %

utilization rate for buckling

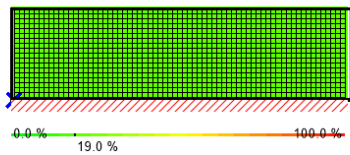


LCO14

Id	X	Z	I_k	λ_y	β_c	$k_{c,y}$	$f_{c,d}$	$\sigma_{c,0,d}$	$\sigma_{m,y,d}$	ratio
[-]	[m]	[m]	[m]	[-]	[-]	[-]	[N/mm ²]	[N/mm ²]	[N/mm ²]	[%]
1	0.075	0	2.763	77	0.2	0.514	13.44	1.32	0.00	19 %

Ultimate limit state (ULS) fire design - results


utilization rate of shear stress in plane on net section

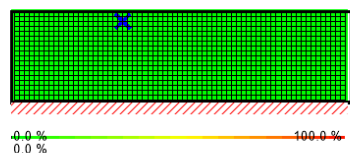

LCO5

Id	X	Z	k_{mod}	$f_{IP,Netto,k}$	Q	$T_{IP,Net,d}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[N/mm ²]	[%]
1179	3.375	2.475	1	3.9	0.00	0.00	0 %


utilization rate of shear stress in plane of gross section

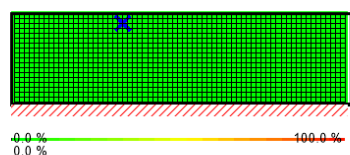

LCO5

Id	X	Z	k_{mod}	$f_{v,IP,Brutto,k}$	Q	$\tau_{IP,Gross,d}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[N/mm ²]	[%]
1179	3.375	2.475	1	3.5	0.00	0.00	0 %


utilization rate of torsional shear stress in face glued surfaces

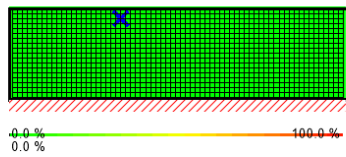

LC05

Id	X	Z	k_{mod}	$f_{v,IP,T,k}$	Q	$T_{T,Node,d}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[N/mm ²]	[%]
1179	3.375	2.475	1	2.5	0.00	0.00	0 %


utilization rate of axial force horizontal

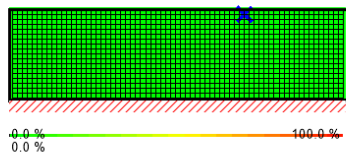

LC05

Id	X	Z	k_{mod}	$f_{m,k}$	$N_{h,max}$	M_y	$\sigma_{h,max}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[kNm]	[N/mm ²]	[%]
1272	7.125	2.625	1	24.0	0.0000	0.0000	0.00	0 %


utilization rate of axial force vertical

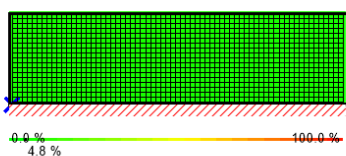

LC05

Id	X	Z	k_{mod}	$f_{m,k}$	$N_{v,max}$	M_y	$\sigma_{v,max}$	ratio
[-]	[m]	[m]	[-]	[N/mm ²]	[kN]	[kNm]	[N/mm ²]	[%]
1	0.075	0	1	24.0	6.0235	0.0000	1.34	5 %

utilization rate for buckling

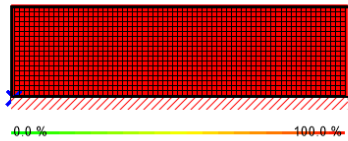


LC05

Id	X	Z	l_k	λ_y	β_c	$k_{c,y}$	$f_{c,d}$	$\sigma_{c,0,d}$	$\sigma_{m,y,d}$	ratio
[-]	[m]	[m]	[m]	[-]	[-]	[-]	[N/mm ²]	[N/mm ²]	[N/mm ²]	[%]
1	0.075	0	2.763	319	0.2	0.036	24.15	1.34	0.00	155 %

Service limit state design (SLS) - design results

horizontal deformation



LC05

Id	X	Z	w_{limit}	limit	$v_{h,max}$	ratio
[-]	[m]	[m]	[mm]	[mm]	[mm]	[%]
1373	1.875	2.763	9.2	$L/300 = 9.2$ $L/300 = 9.2$	0.0000	0.0 %


support reaction

support reaction horizontal min/max

min=0.00 / max=0.00 [kN/m]



support reaction vertical min/max

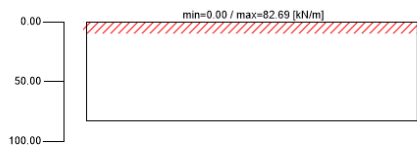

support reaction moment min/max

min=0.00 / max=0.00 [kNm/m]




fire support reaction

fire support reaction horizontal min/max

min=0.00 / max=0.00 [kN/m]



fire support reaction vertical min/max

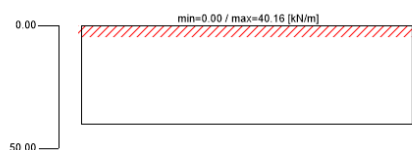

fire support reaction moment min/max

min=0.00 / max=0.00 [kNm/m]



Disclaimer

The software was created to assist engineers in their daily business. The software is an engineering software that is dealing with a very complex matter of structural analysis and building physics analysis. Therefore, this software shall only be operated by skilled, experienced engineers, with a deep understanding of structural engineering and building physics related to timber structures. The user of the software is obliged to check all input values, no matter if they were given by the user or given by default by the software and all results for plausibility.

The use of the results of the software should not be relied upon as the basis for any decision or action. Any use of results of the software is only allowed, if the results have been verified and approved regarding completeness and correctness by a project structural/building physics engineer. The user has the possibility to make print-outs from the software. Any modification of those are not allowed.

Stora Enso Wood Products GmbH does not assume any warranty regarding the software. The software has been developed with utmost diligence, nevertheless Stora Enso Wood Products GmbH, neither expressly nor implicitly, provides any warranty in terms of accuracy, validity, timeliness and completeness of information and data created by the software. Stora Enso Wood Products GmbH does also not assume any warranty for the general usability of the software, its suitability for a special purpose or for the compatibility of the software with the ones of third party producers or providers.

Stora Enso Wood Products GmbH is only liable for damages caused by gross negligence or intent through Stora Enso Wood Products GmbH; the liability for slight negligence is excluded. This does not apply to personal injury. Under the aforementioned conditions Stora Enso Wood Products GmbH is as well not liable for operational failures or the loss of programs and/or data of the user's data processing system.

Applicable Law: These terms of use shall be governed by the laws of Austria excluding however any conflict of laws rules and any laws regarding the Convention of the International Sale of Goods (CISG).